


## BLINK SOLAR

# 30KVA-UPS battery cabinet installation method

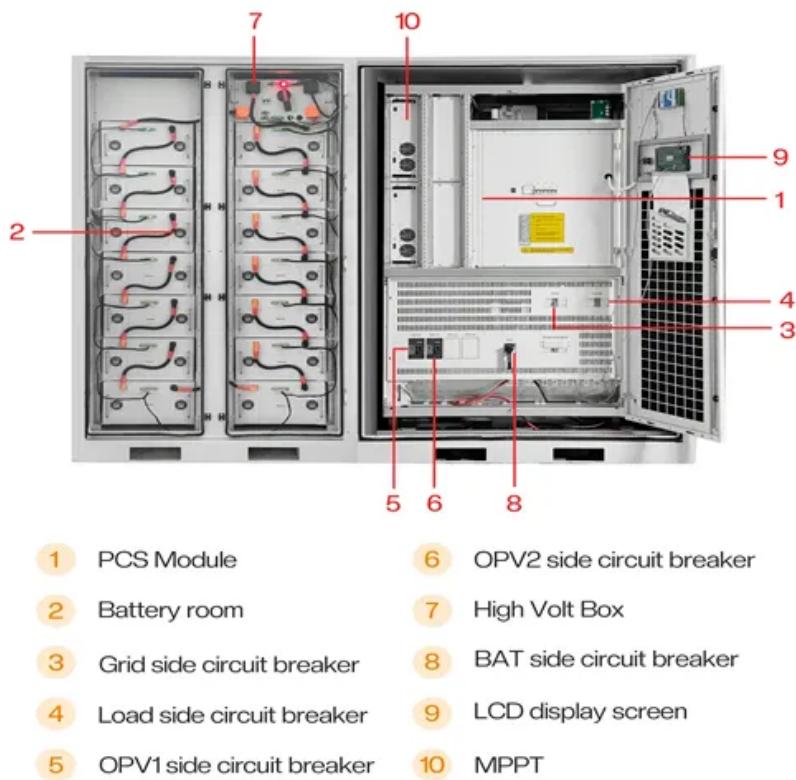

## Overview

---

Can I use an external battery cabinet with a ups?

External battery cabinets cannot be used in combination with a UPS containing internal batteries. The UPS must be supplied without internal batteries. The EBC is designed to be installed in a line-up-and-match or standalone configurations.

How many batteries are in a 9355 20-30 kVA ups?

The total battery string voltage in a 9355 20-30 kVA UPS is 216V (18 batteries, where each battery is 12V nominal). Two strings fit in each battery shelf of the 9355 20-30 kVA UPS. The two-row tray configuration that is being replaced holds 18 batteries, connected to make one circuit.

Where do I install a line-up and match Battery Cabinet?

Line-up-and-match battery cabinets are installed adjacent to the UPS. The recommended installation location is on the right side of the UPS cabinet. See Figure 1-2 and Figure 1-3 for line-up-and-match configuration views. Contains two or three battery strings to be used with the 93E 30 kVA UPS.

How many Battery strings can a 93e 30 kVA ups have?

Contains two or three battery strings to be used with the 93E 30 kVA UPS. Up to two EBCs with a total of four or six battery strings can be paralleled together to extend the run time. To configure a 30EBC battery system with four strings, two 30EBCs, each with two strings, must be used.

## 30KVA-UPS battery cabinet installation method

---



### Eaton 9355 (20/30 kVA) UPS battery upgrade instructions

The total battery string voltage in a 9355 20-30 kVA UPS is 216V (18 batteries, where each battery is 12V nominal). Two strings fit in each battery shelf of the 9355 20-30 ...

## User's Guide UPS 20

er source. The electrical installation procedure is described in the following text. The installation inspection and initial start up of the UPS and extra battery cabinet must be ...

### APPLICATION SCENARIOS

---



### 30KVA-600KVA UPS Installation and Operation Manual

The liquid might spill into the UPS causing internal damage or cause electrocution. (8) Ensure the battery specifications match the UPS requirements before connecting any ...

## **Liebert® EXS External Battery Cabinet Installer/User Guide**

30 1 Important Safety Instructions This manual contains important instructions that should be followed during installation of your VertivTM Liebert® EXS Battery Cabinet and ...



### **External Battery Cabinet (EBC) installation procedure**

The installation procedure is as follows:  
1.The External Battery Cabinet (EBC) is recommended to be placed to left hand side of the UPS unit. 2.The required minimum distance for UPS unit and ...

## **Easy UPS 3S 10-30 kVA 3:1 UPS for External Batteries Installation**

Providing the certified electrician with information on how to install and connect the Easy UPS 3S



### **Installing the UPS Cabinet**

Secured Installation Determine the position for installing the UPS cabinet. Mark mounting holes based on the



drawings or marking-off template. Figure 4-7 Mounting holes (unit: mm) Drill ...

---

## **Eaton 93E external battery cabinet installation manual**

Introduction The Eaton® External Battery Cabinet (EBC) provides extended emergency short-term backup power for the 93E 20-30 kVA and 40-60 kVA UPS to enhance ...



### **Single UPS Installation (30 kVA/40 kVA)**

Take a battery string consisting of 40 batteries for example. The battery neutral wire is routed from the middle of positive and negative battery strings, each consisting of 20 batteries.

---

## **Eaton 93E UPS Generation 3 (20-30 kVA, 208V/220V) ...**

Battery backup protection with additional runtime can be provided by

equipping the UPS system with up to two External Battery Cabinets (EBCs) containing sealed lead-acid, ...



---

## Contact Us

---

For catalog requests, pricing, or partnerships, please contact:

### **BLINK SOLAR**

Phone: +48-22-555-9876

Email: [info@blinkartdesign.pl](mailto:info@blinkartdesign.pl)

Website: <https://blinkartdesign.pl>

*Scan QR code to visit our website:*

